


## Through Roof Assembly



### Notes:

1. BEA engineering staff must spot meter base location prior to meter base installation.
2. If length of conduit exceeds 10 feet, coupling must be below roof line.
3. Anchor required should extend 3' above roof.
4. Intersystem bonding termination strip required on all residential services.
5. Two ground rods required, minimum 6 foot separation.
6. The through roof assembly must pass a State of Tennessee electrical inspection prior to BEA service connection.

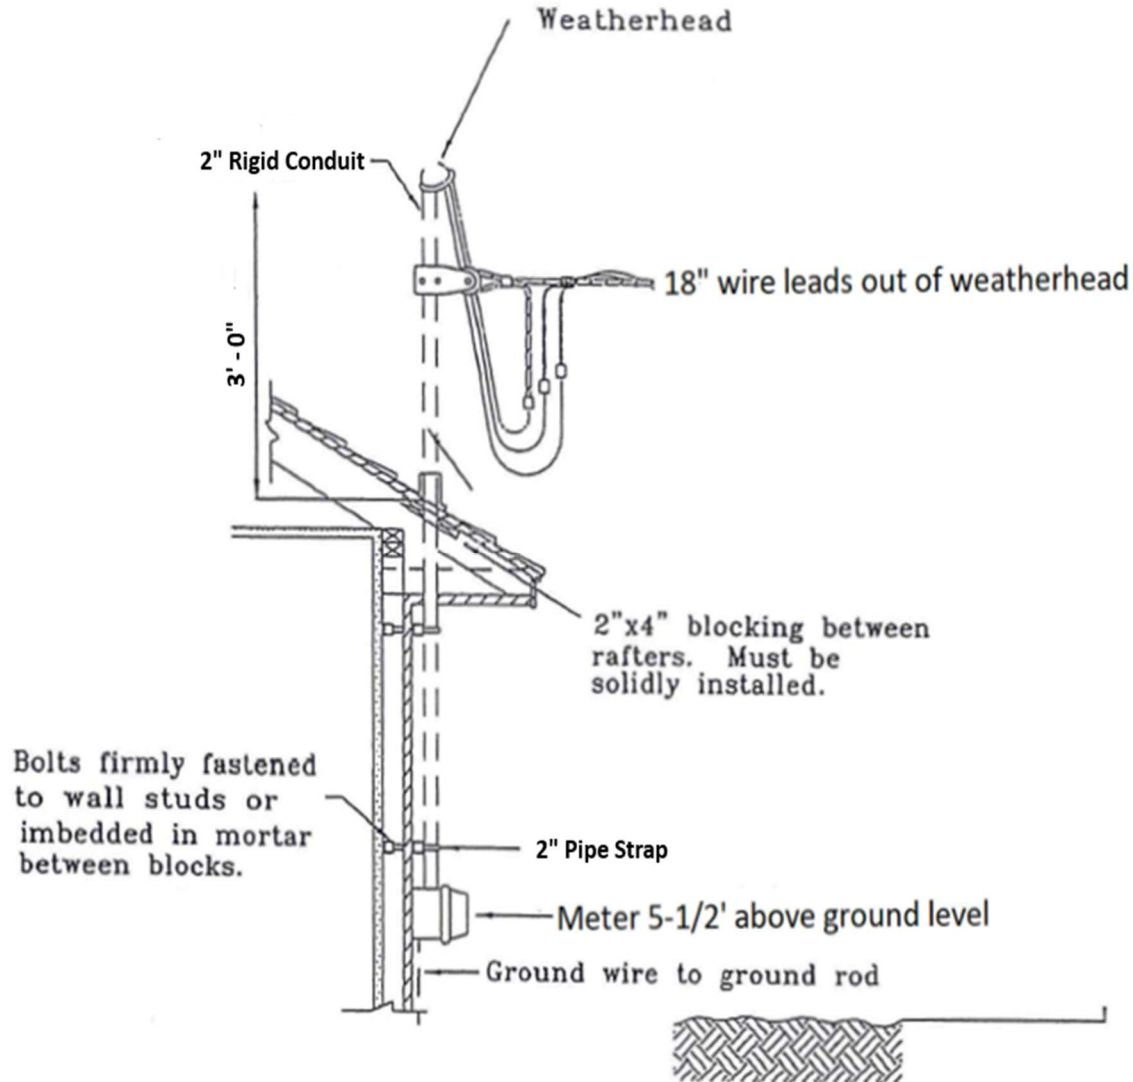

## Overhead Service

